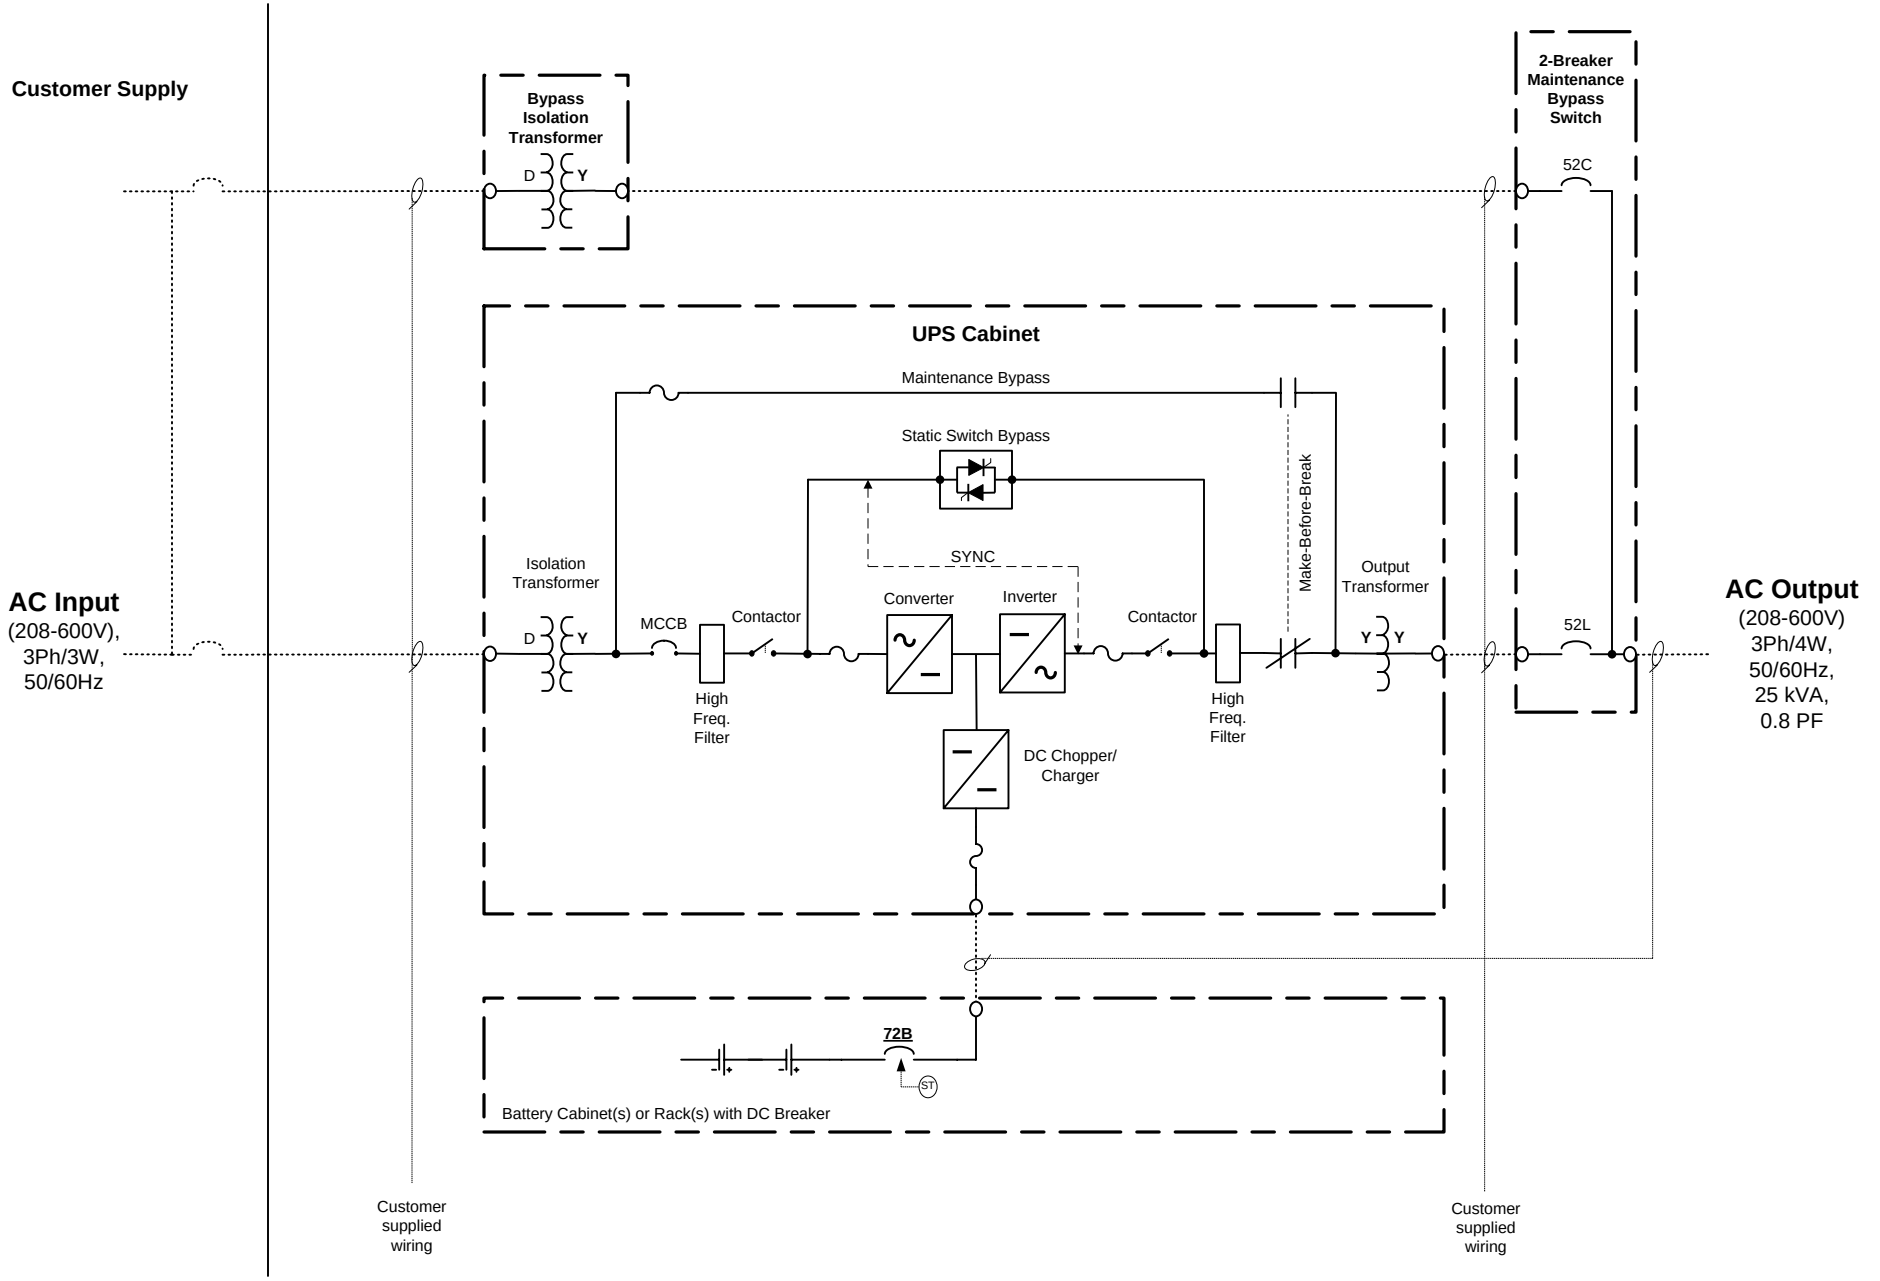

NOTES
1) This drawing is for illustration purposes only and is subject to change without notice. TIC is not responsible for any errors or omissions.
2) A Maximum of 2 transformers can be equipped within the standard UPS cabinet.
3) An output transformer is not equipped in models with 208/120V output.

Drawn by EO
DATE 03/25/04

Approved by JIS
DATE 03/25/04

TOSHIBA
INTERNATIONAL CORPORATION
Houston Texas, USA

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF TOSHIBA INTERNATIONAL CORPORATION AND SHALL NOT BE REPRODUCED, USED, OR DISCLOSED TO OTHERS UNLESS PRIOR WRITTEN AUTHORIZATION IS OBTAINED.

TITLE: One-Line Drawing
4200***FA*** **XT2** UPS, 25 kVA Capacity
Single Input Transformer Model,
shown with External Bypass Transformer and
External 2-Breaker Maintenance Bypass Switch

DRAWING NO. T42X3X250XAMXN

REV. 1.2